


NOTE: GREEN GROUND WIRE REQUIRED IN ALL CONDUITS, SIZED PER N.E.C. REQUIREMENTS.

YES001

UNDER SLAB CONDUIT N.T.S.

7

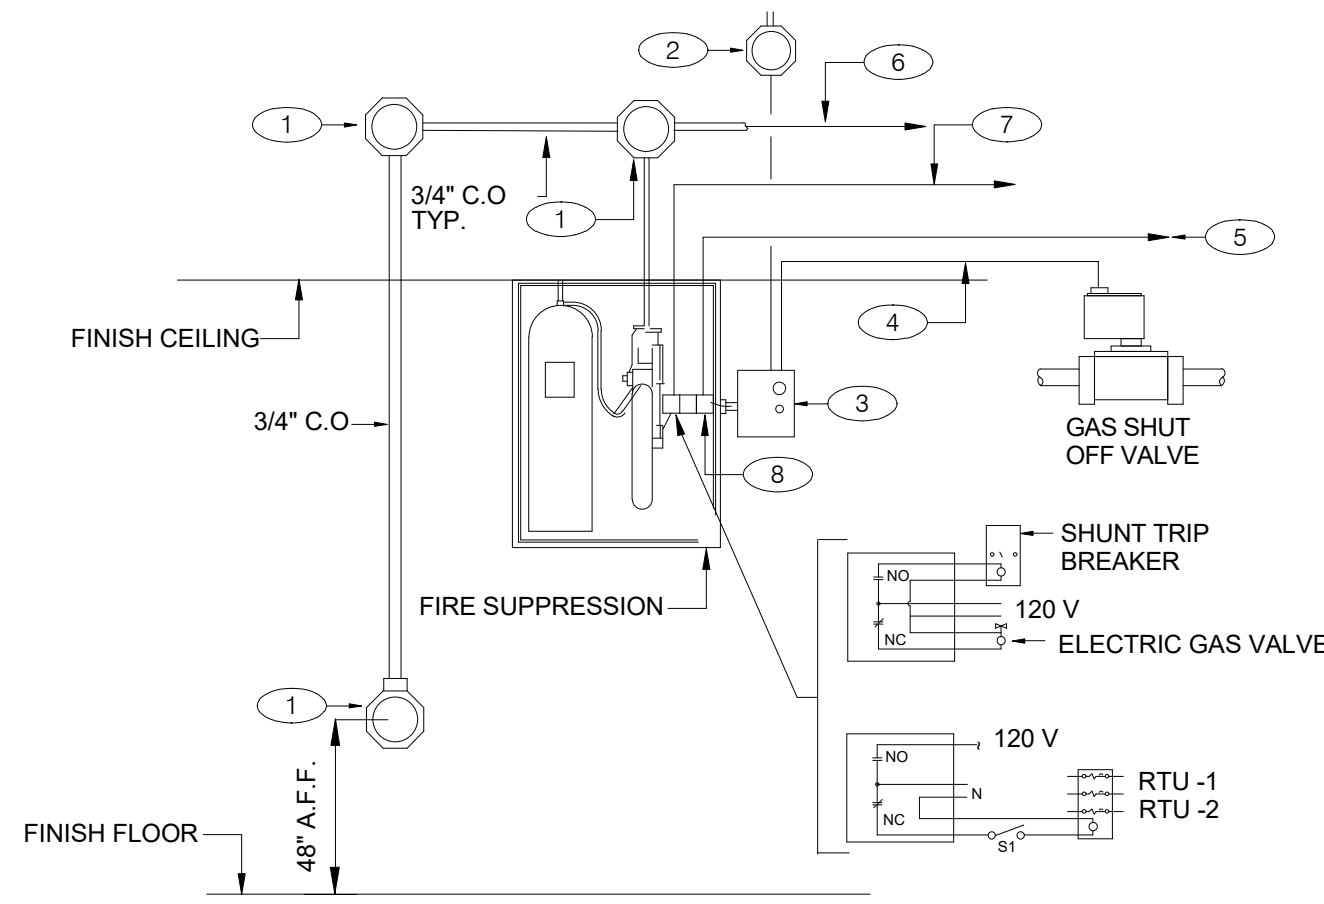


GENERAL NOTES:

1. REFER TO SHEET M3.0
- KEY NOTES:**
- 1 PROVIDE 4" OCTAGONAL J-BOX.
 - 2 PROVIDE J-BOX, AND 110 V CIRCUIT. REFER TO EQUIPMENT SCHEDULE/FLOOR PLAN FOR CIRCUIT ASSIGNMENT. CONNECT TO TBANS. SEE SHEET 7.1.
 - 3 TBANS INSTALLED BY ELECTRICAL CONTRACTOR.
 - 4 PROVIDE CONNECTIONS TO TBANS BOX FOR HOOD SHUTDOWN. SEE SHEET E7.1 FOR TBANS WIRING DIAGRAM.
 - 5 PROVIDE 1/2" C WITH CONTROL CABLE. MAKE INTERCONNECTIONS TO EXHAUST & SUPPLY FAN INTERFACE THROUGH MICROSWITCH ON HOOD.
 - 6 CABLE AND CONNECTION TO FUSIBLE LINKS AT EXHAUST HOOD BY K.E.C.
 - 7 PROVIDE INTERCONNECTION BETWEEN FIRE SUPPRESSION MICROSWITCH AND TBANS. SEE SHEET E7.1.
 - 8 FIRE SUPPRESSION SYSTEM TO INCLUDE TWO MICROSWITCHES. EACH MICROSWITCH SHALL HAVE A COMMON, NORMALLY OPEN AND NORMALLY CLOSED POLE.


FIRE SUPPRESSION SYSTEM WIRING DIAGRAM N.T.S.

4

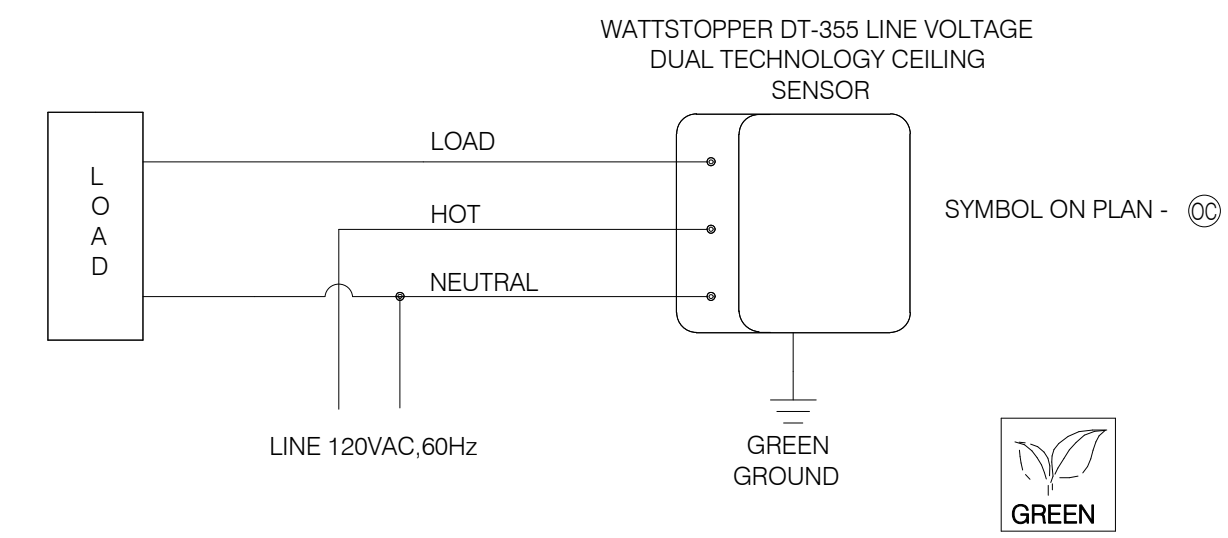

CEILING OCCUPANCY SENSOR WIRING DIAGRAM N.T.S.

2

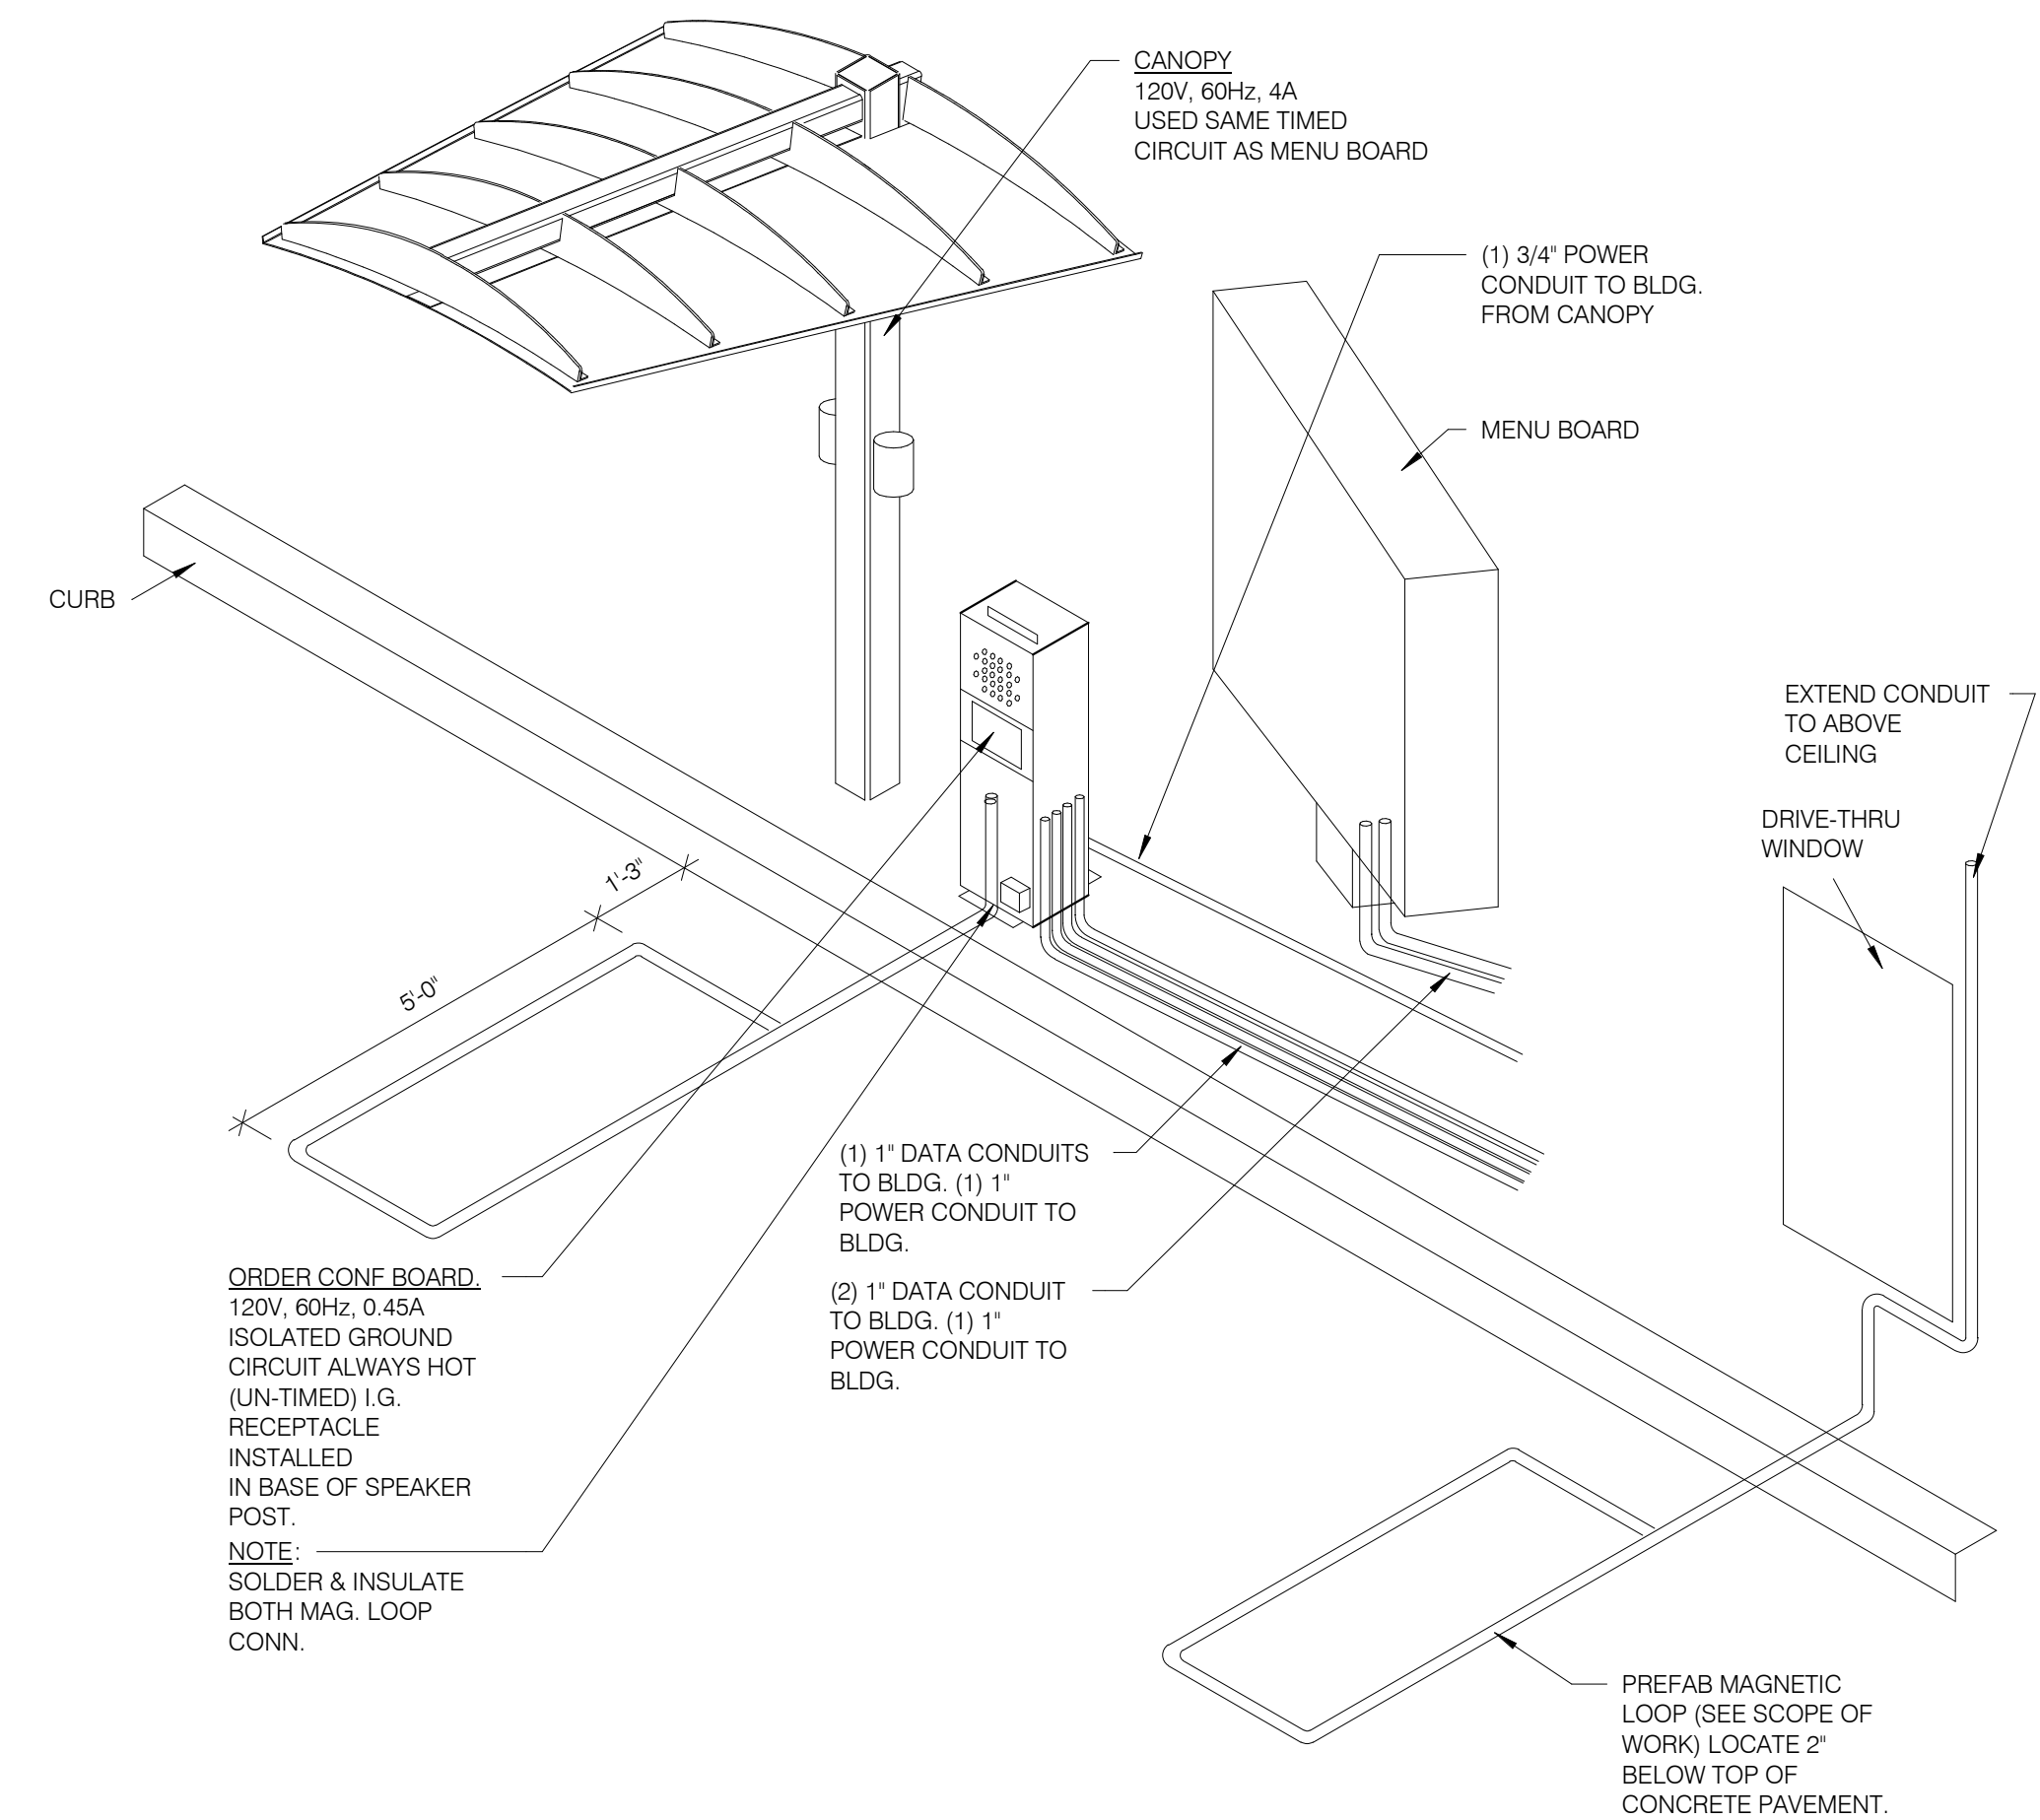

DRIVE-THRU COMMUNICATIONS ISOMETRIC N.T.S.

YES006A

3

NOT USED N.T.S.


8

NOT USED N.T.S.

5

NOT USED

NOT USED

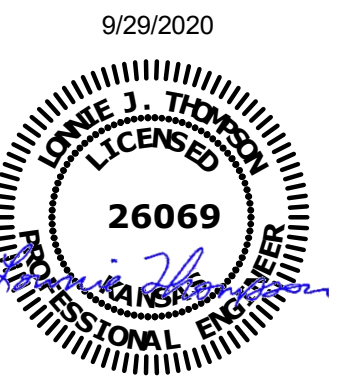

18048.20003

1		

CONTRACT DATE:
BUILDING TYPE: END. MED40
PLAN VERSION: MARCH 2020
SITE NUMBER:
STORE NUMBER:

TACO BELL
615 METROPOLITAN AVE
LEAVENWORTH, KS 66048




**ENDEAVOR 1.0
ELECTRICAL
DETAILS**

E7.0

PLOT DATE: 9/30/2020 2:29:33 PM

BC PROJECT #: 20684
KANSAS PE COA #E-359
This drawing has been prepared by the Engineer, or under his supervision. This drawing is provided as an instrument of service by the Designer/Engineer and is intended for use on this project only. Pursuant to the Architectural Works Copyright/Protection Act of 1990, all drawings, specifications, ideas and designs, including the overall form, arrangement and composition of spaces and elements appearing herein, constitute the original, copyrighted work of the Designer/Engineer. Any reproduction, use, or disclosure of information contained herein without prior written consent of the Engineer is strictly prohibited. © 2020 BC Engineers, Inc.

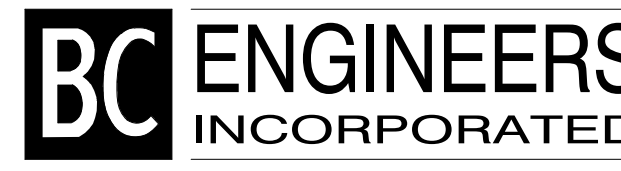

5720 Reeder Shawnee, Ks. 66203 (913)262-1772

\\server\shared\IT\projects\2020\20684\KANSAS\MEP\20684_MEP-E7.0.dwg